

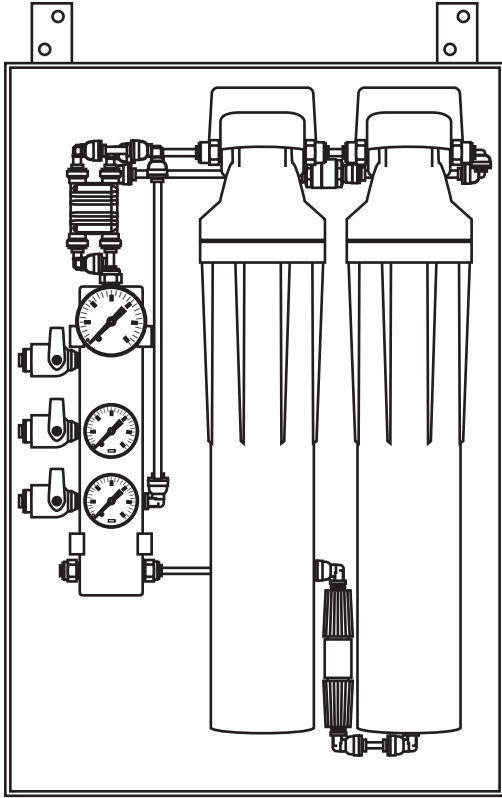



Suggested Mounting Options

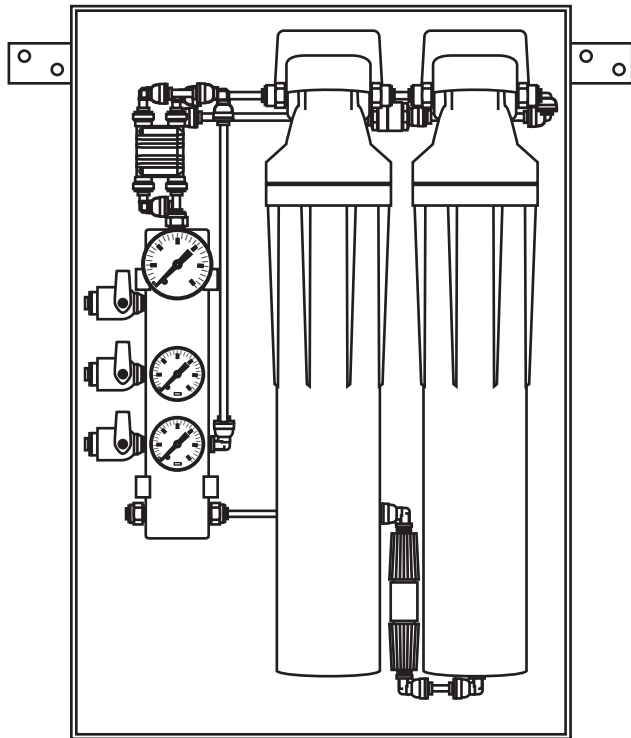

*Min 2" ↑

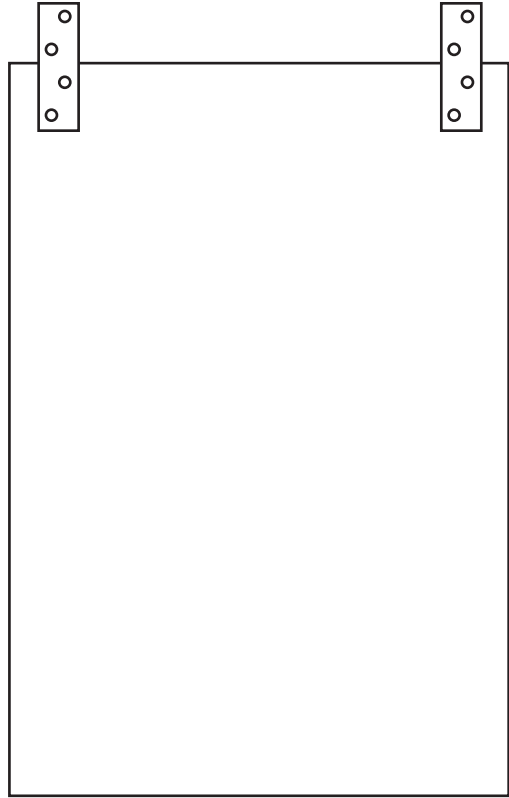

*Min 2" ↑

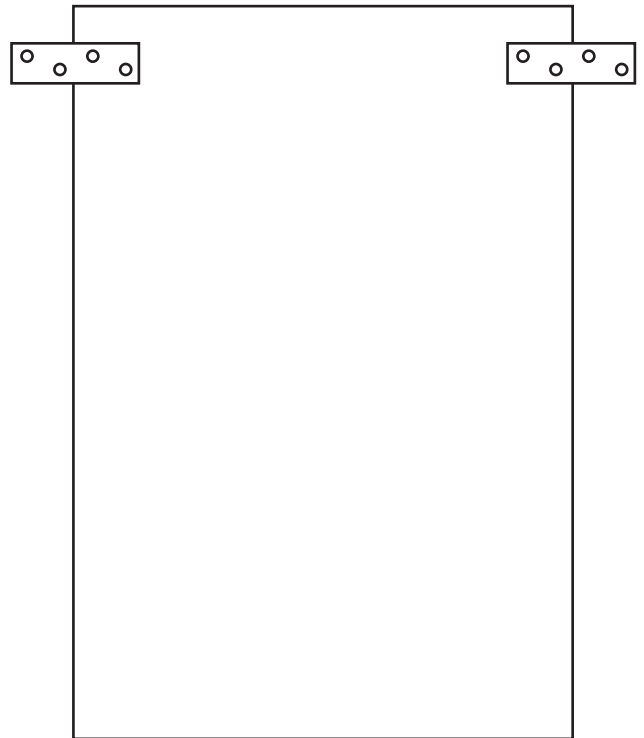

* Mount units with at least 2" clearance at bottom to allow filter element replacement